




CONCRETE ANCHOR WALLS (CLASS 3000) SHALL BE CONSTRUCTED USING FORMS WHEN SEWERS, STORM DRAINS, AND OTHER PIPELINES ARE CONSTRUCTED WITH SLOPES 20 PERCENT OR GREATER. REMOVE FORMS PRIOR TO BACKFILLING TRENCH.

MIN. SPACING OF ANCHOR WALLS:

<u>SLOPE:</u> 20–35%	<u>SPACING:</u> 35 FEET
35–50%	25 FEET
>50%	15 FEET OR SPECIAL DESIGN

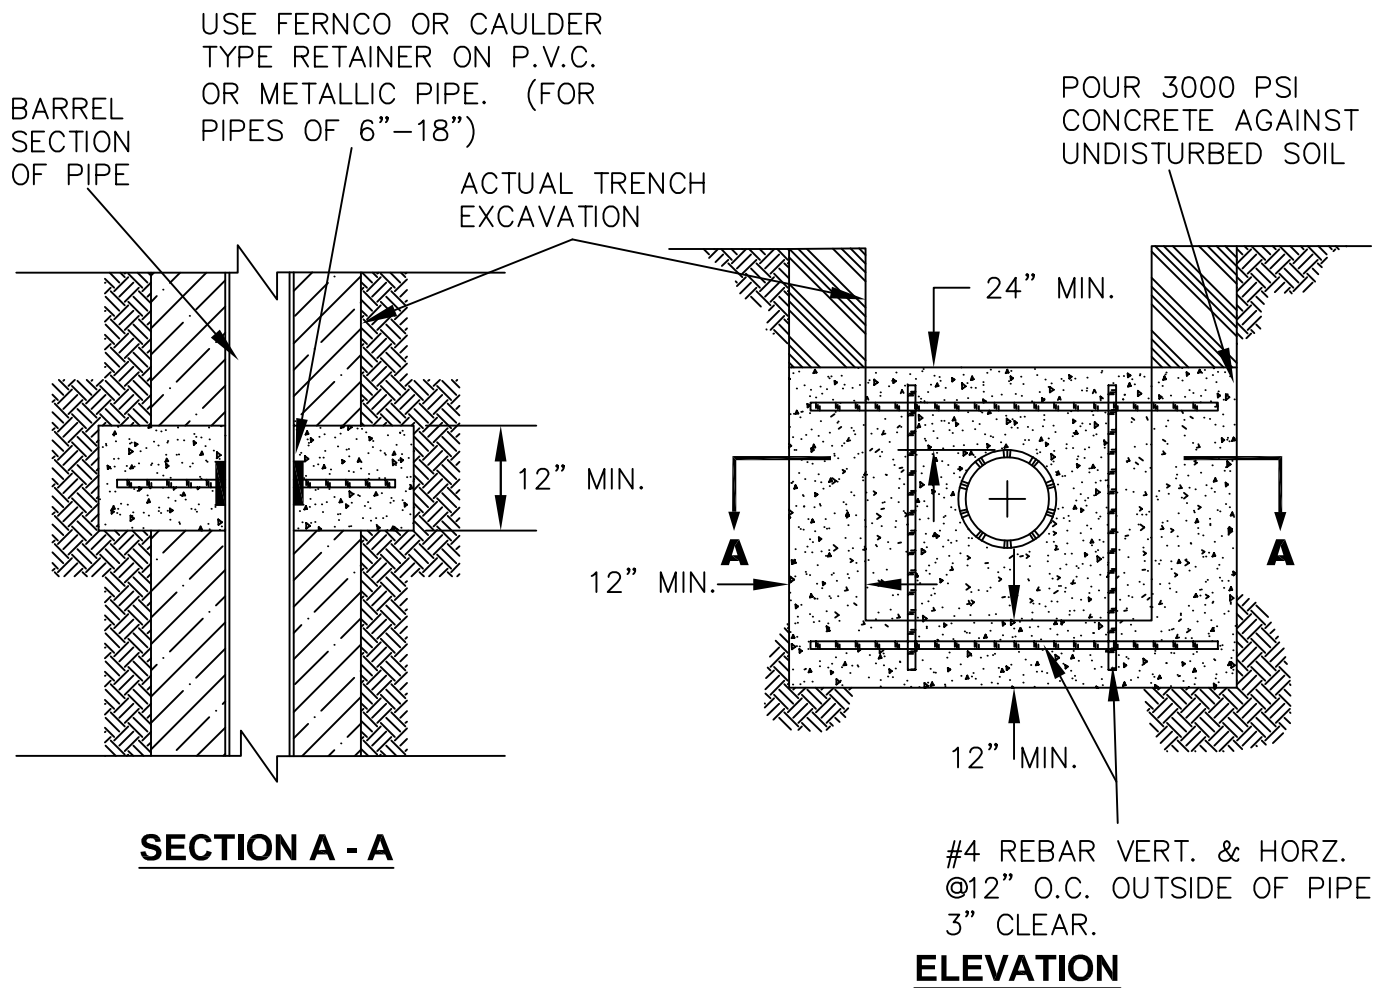

Public Works Standard Drawings

PIPE ANCHOR WALL

SCALE	NTS
DATE JAN '23	REV.
ENGR. DW	DRAWN KAE
DRAWING NO.	605