


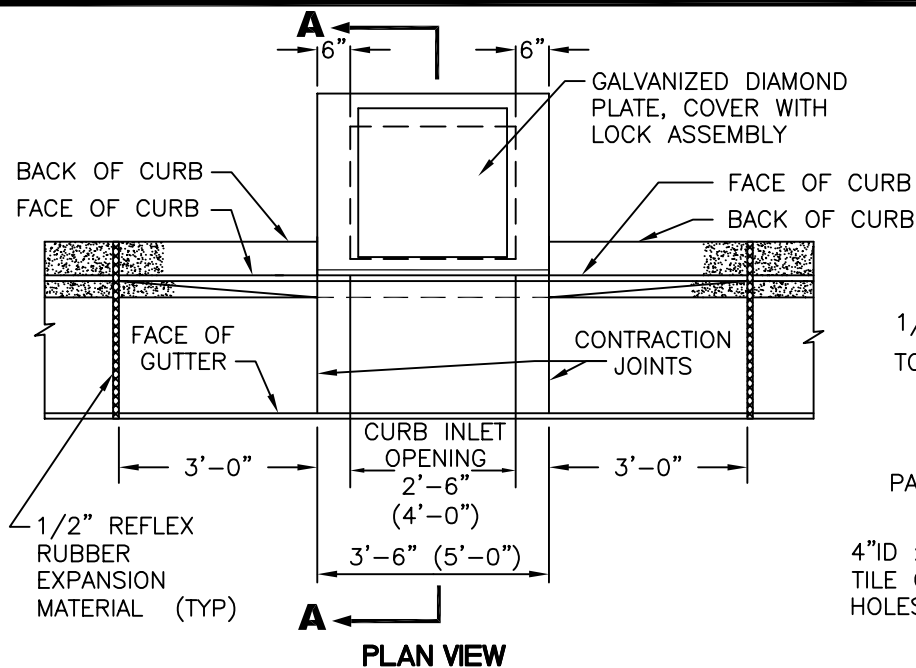



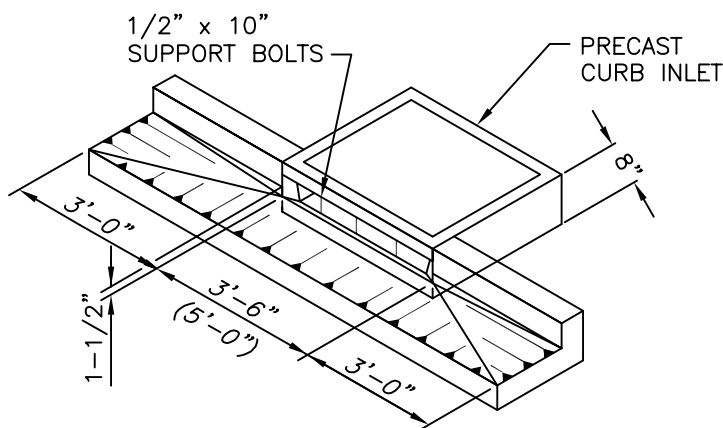

MANHOLE RING AND COVER
SEE DRAWING 305

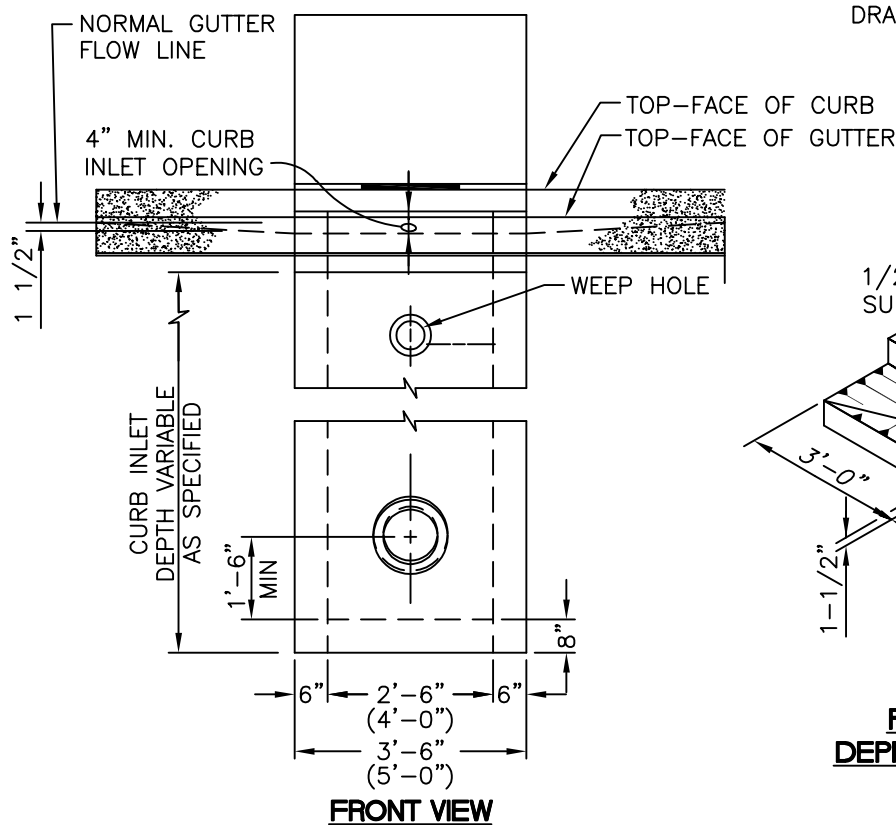

OPTIONAL COVER

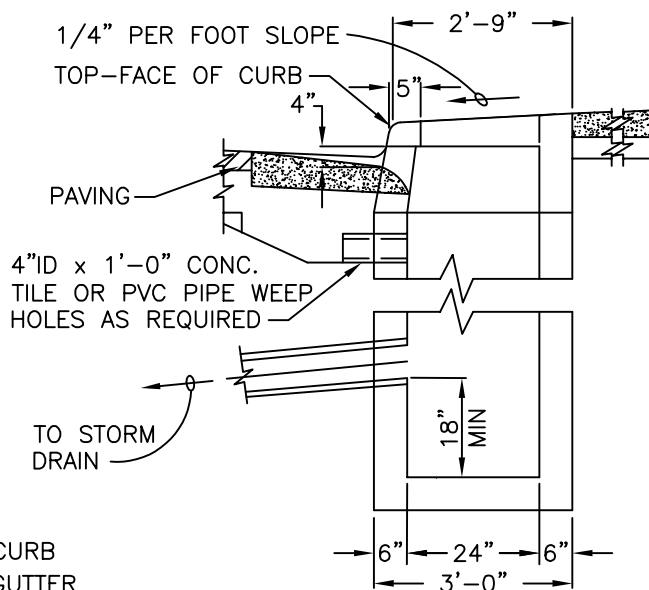

NOTES:

1. CURB INLET TOP AND BASE SHALL MEET H-20 LOADING
2. CONCRETE STRENGTH SHALL BE 3000 PSI.
3. ALL FABRICATED METAL PARTS SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
4. FOR STEEP GRADES USE STD. PRECAST INLET WITH 4'-0" OPENING OR TWO 2'-6" OPENING INLETS.
5. CURB INLET BASE MAY BE PRECAST OR CAST-IN-PLACE.
6. DIMENSIONS SHOWN ABOVE IN PARENTHESES ARE FOR 4A INLETS. A 1 1/2 A INLET SHALL HAVE A CURB INLET OPENING WIDTH OF 1'-6" AND AN OUTSIDE WIDTH OF 2'-6"; ALL OTHER DIMENSIONS AND DETAILS SHALL BE AS SHOWN.

Public Works Standard Drawings

PRECAST CURB INLET
1 1/2 A, 2 21/2 A, 4 A

SCALE NTS

DATE JAN '23 REV.

ENGR. DW DRAWN KAE

DRAWING NO. 609

