




Public Works Standard Drawings

SANITARY SEWER SERVICE

SCALE		NTS	
DATE	JUN '24	REV.	2
ENGR.	DW	DRAWN	KAE
DRAWING NO. 310			

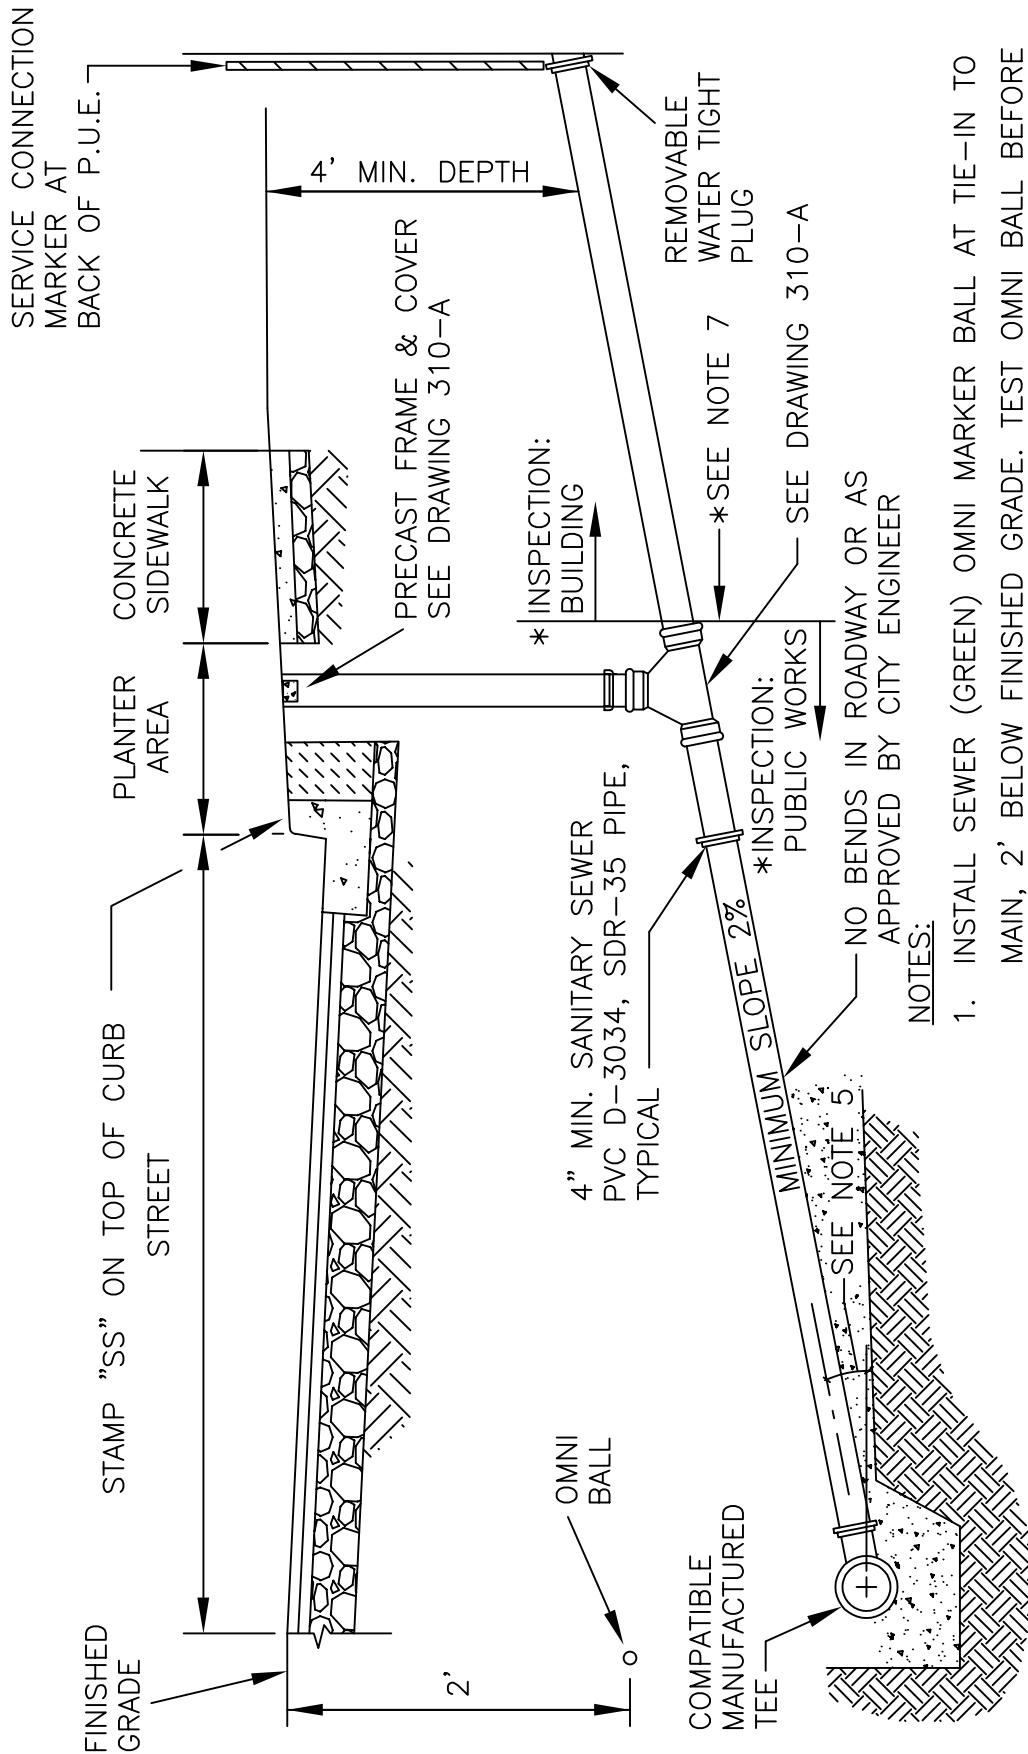

NOTES:

1. INSTALL SEWER (GREEN) OMNI MARKER BALL AT TIE-IN TO MAIN, 2' BELOW FINISHED GRADE. TEST OMNI BALL BEFORE INSTALLATION AND AGAIN AFTER FINISHED GRADE IS PLACED. OMNI BALL-SANITARY-GREEN, FREQUENCY 121.6 KHz, MODEL 162, UPC 60767.
 2. INSTALL 2-WAY CLEANOUT PER STANDARD DRAWING 310-A.
 3. VIDEO INSPECT LATERAL BETWEEN MAINLINE AND CLEANOUT PER APPLICABLE APWA/ODOT STANDARDS.
 4. 2" x 4" TREATED STAKE FROM INVERT TO 1' ABOVE FINISH GRADE. SERVICE MARKER SHALL BE CONTINUOUS AND REMAIN VERTICAL AFTER BACKFILLING. END SHALL BE PAINTED GREEN. (TYPICAL AT ALL SERVICES.)
 5. CENTERLINE OF SERVICE OUTLET ON TEE SHALL BE ABOVE SPRINGLINE.
 6. SANITARY SEWER SERVICE LINES SHALL BE 90° PERPENDICULAR TO SANITARY SEWER MAIN.
 7. CONTACT BUILDING DEPARTMENT FOR INSPECTIONS OF THE SERVICE BETWEEN CLEANOUT AND THE BUILDING.
- * DOES NOT APPLY TO NEW SUBDIVISIONS.