




## Public Works Standard Drawings

### STORM SEWER SERVICE

|             |         |           |
|-------------|---------|-----------|
| SCALE       | NTS     |           |
| DATE        | JAN '23 | REV.      |
| ENGR.       | DW      | DRAWN KAE |
| DRAWING NO. | 612     |           |

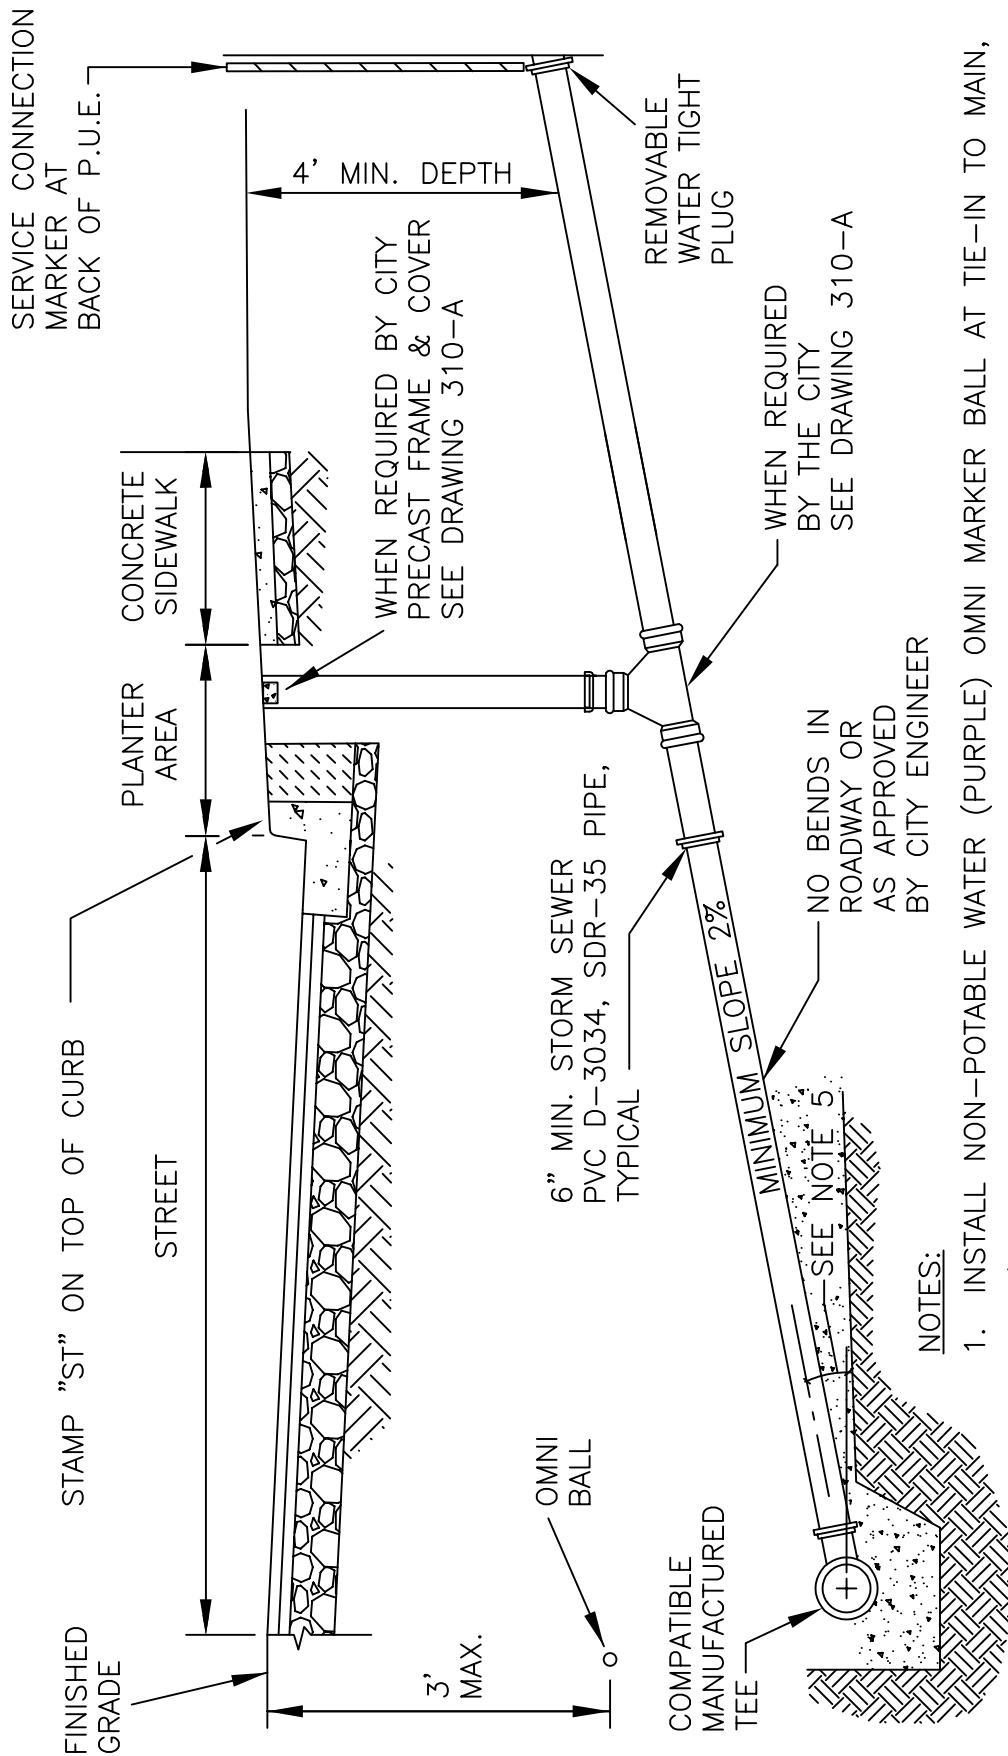

#### NOTES:

1. INSTALL NON-POTABLE WATER (PURPLE) OMNI MARKER BALL AT TIE-IN TO MAIN, 3' BELOW FINISHED GRADE. TEST OMNI BALL BEFORE INSTALLATION AND AGAIN AFTER FINISHED GRADE IS PLACED. OMNI BALL-NON-POTABLE WATER-PURPLE, FREQUENCY 66.35 KHz, MODEL 168, UPC 11050.
2. WHEN REQUIRED BY THE CITY, INSTALL 2-WAY CLEANOUT PER STANDARD DRAWING 310-A.
3. VIDEO INSPECT LATERAL BETWEEN MAINLINE AND CLEANOUT PER APPLICABLE APWA/ODOT STANDARDS.
4. 2" x 4" TREATED STAKE FROM INVERT TO 1' ABOVE FINISH GRADE. SERVICE MARKER SHALL BE CONTINUOUS AND REMAIN VERTICAL AFTER BACKFILLING. END SHALL BE PAINTED WHITE WITH "STM" MARKED ON POST. (TYPICAL AT ALL SERVICES.)
5. CENTERLINE OF SERVICE OUTLET ON TEE SHALL BE ABOVE SPRINGLINE.
6. STORM SEWER SERVICE LINES SHALL BE 90° PERPENDICULAR TO STORM SEWER MAIN.